
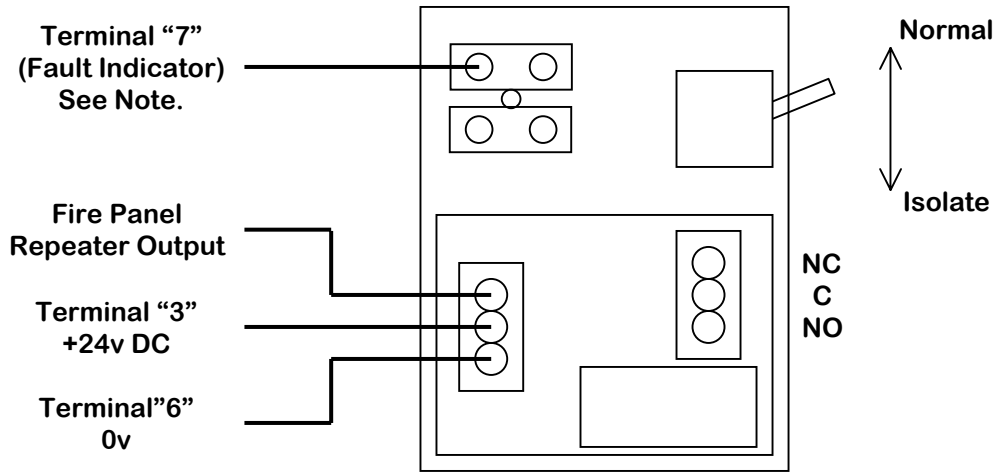


3rd Angle Projection

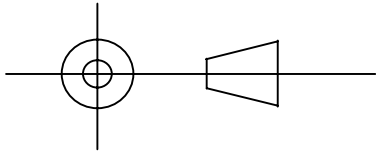

Note:-
If fault indication under isolated
Conditions is required, connect Violet
Wire To terminal "7" on fire panel.
Otherwise leave disconnected.

Drn	Date	Iss	Notes	Scale	Title :- Aux Relay with Isolate / Fault signal
RJW	0105	A	ktauxrelay		
				Finish	Drg No :- 0105 / 16a
Nebula PPS Ltd, Lancing, W Sussex, BN15 8TU, (01903) 766642					